



OVERLAND DISCHARGE LESS THAN 5 FEET FROM BUILDING

NOTE: RECOMMENDED DISTANCE OF 5 FEET FROM FOUNDATION IS TO PREVENT DAMAGE TO FOUNDATION AND MINIMIZE WATER RECIRCULATION BACK INTO BASEMENT

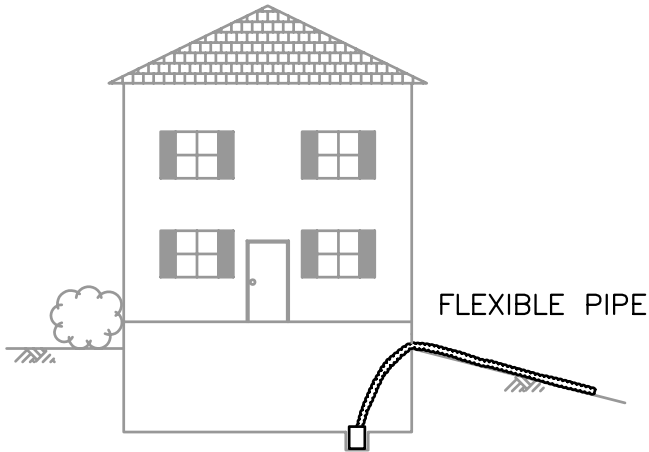

ANY FLEXIBLE DISCHARGE PIPE FROM A SUMP PUMP

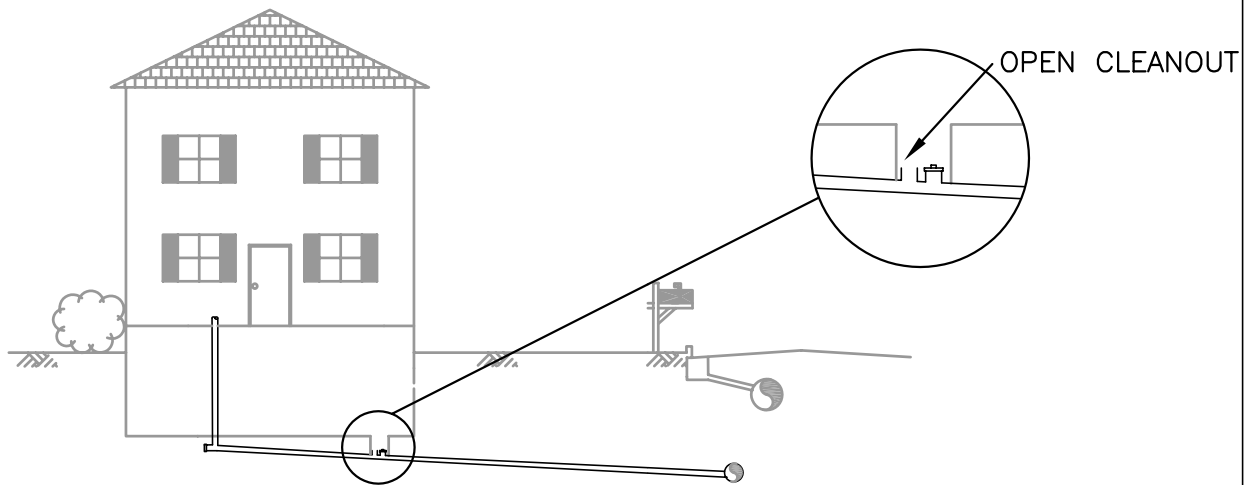

OPEN SEWER CLEANOUT


**CDM**

consulting  
engineering  
construction  
operations


TOWN OF GREENWICH, CONNECTICUT

PRIVATE INFLOW  
SOURCE REMOVAL PROGRAM


ILLICIT DISCHARGE LOCATIONS I

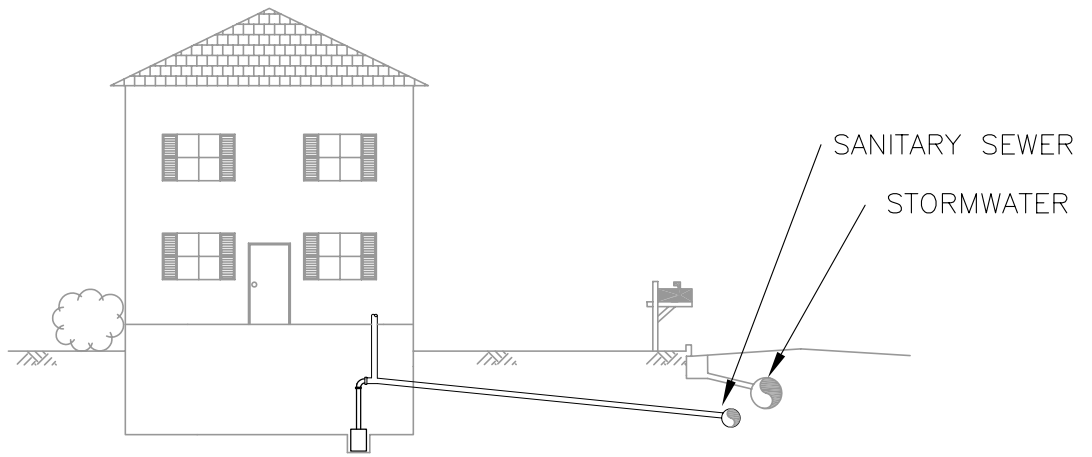

SUMP PUMP DIRECTLY CONNECTED TO SANITARY SEWER

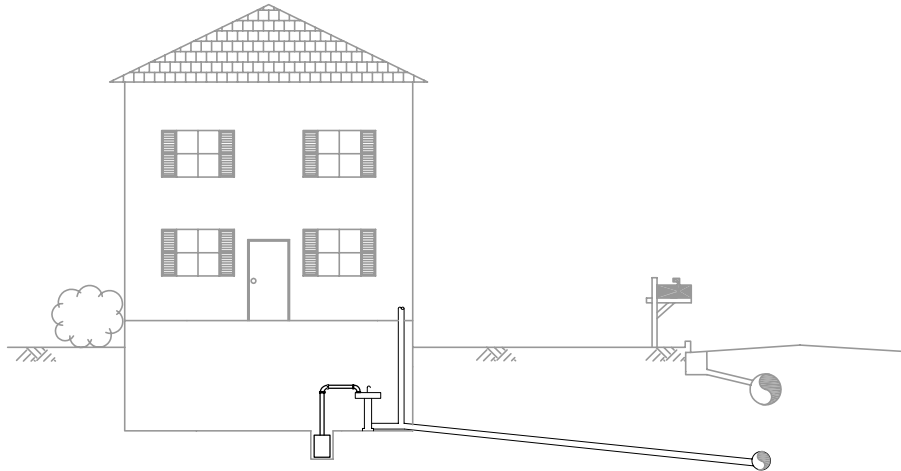


SUMP PUMP CONNECTED TO SANITARY SEWER VIA A WASH SINK

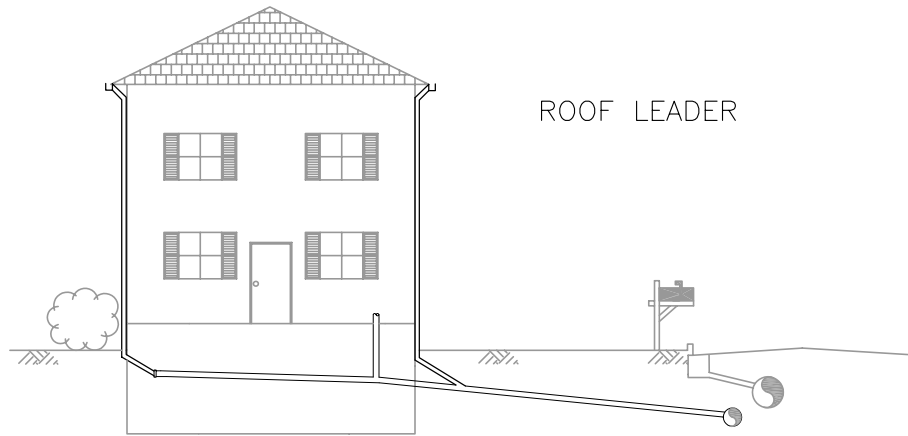

ROOF LEADER

ROOF LEADERS CONNECTED TO SANITARY SEWER

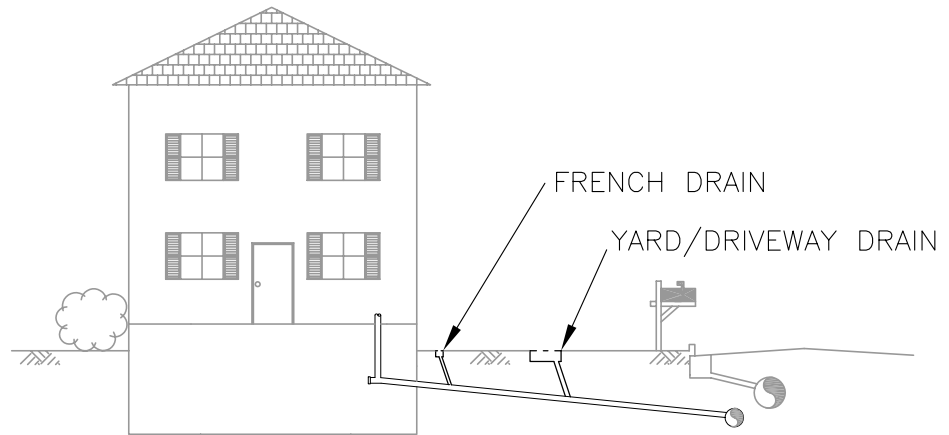

FRENCH DRAIN

YARD/DRIVEWAY DRAIN

DRAINS CONNECTED TO SANITARY SEWER

**CDM**

*consulting  
engineering  
construction  
operations*

TOWN OF GREENWICH, CONNECTICUT

PRIVATE INFLOW  
SOURCE REMOVAL PROGRAM

ILLICIT DISCHARGE LOCATIONS III