



NOTE: RECOMMENDED DISTANCE OF 5 FEET FROM FOUNDATION IS TO PREVENT DAMAGE TO FOUNDATION AND MINIMIZE WATER RECIRCULATION BACK INTO BASEMENT

OVERLAND DISCHARGE: RECOMMENDED AT LEAST 5 FEET FROM BUILDING

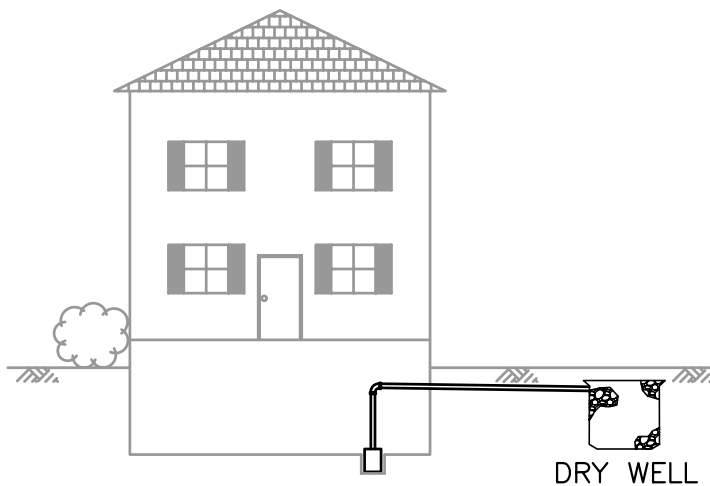

DISCHARGE TO A DRYWELL

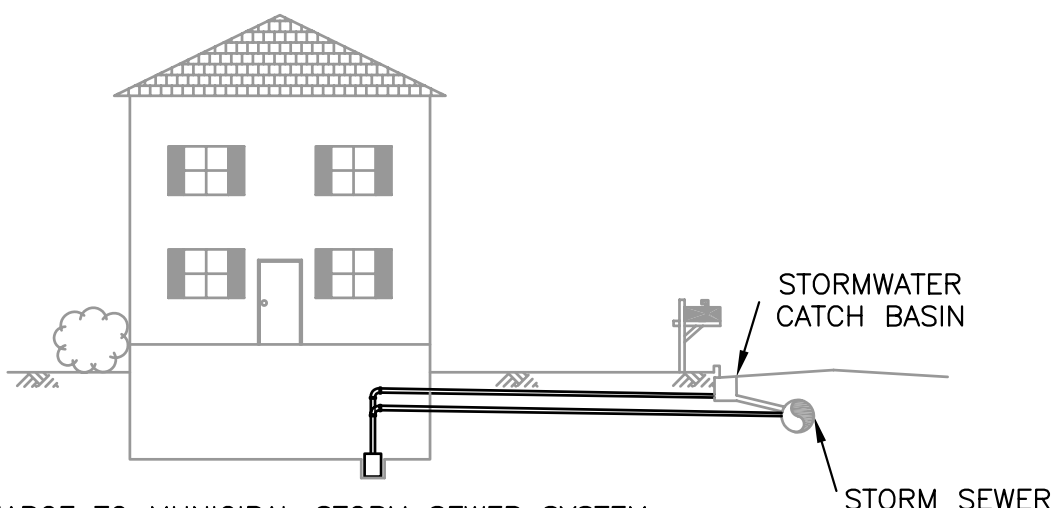

DISCHARGE TO MUNICIPAL STORM SEWER SYSTEM

CDM

*consulting
engineering
construction
operations*

**TOWN OF GREENWICH, CONNECTICUT
PRIVATE INFLOW
SOURCE REMOVAL PROGRAM
ACCEPTABLE DISCHARGE LOCATIONS**